



## Main Current Leads Cryogenic Test Program at STF:

1. 14 kA DC current (A) repeat at HTS temperatures: 50K, ~ 60-54K

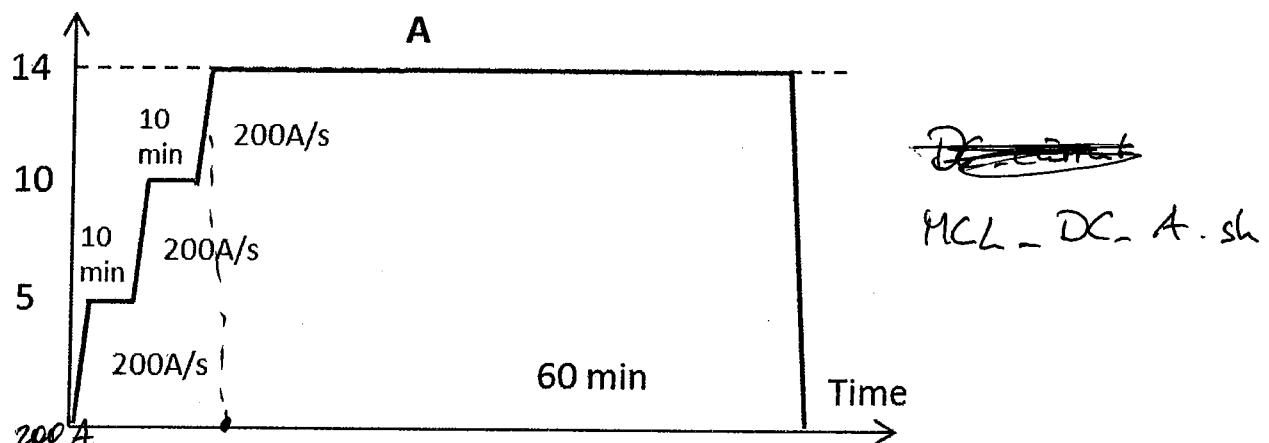

2. 13.2 kA pulse current (B) repeat at HTS temp.: 50K, 60K

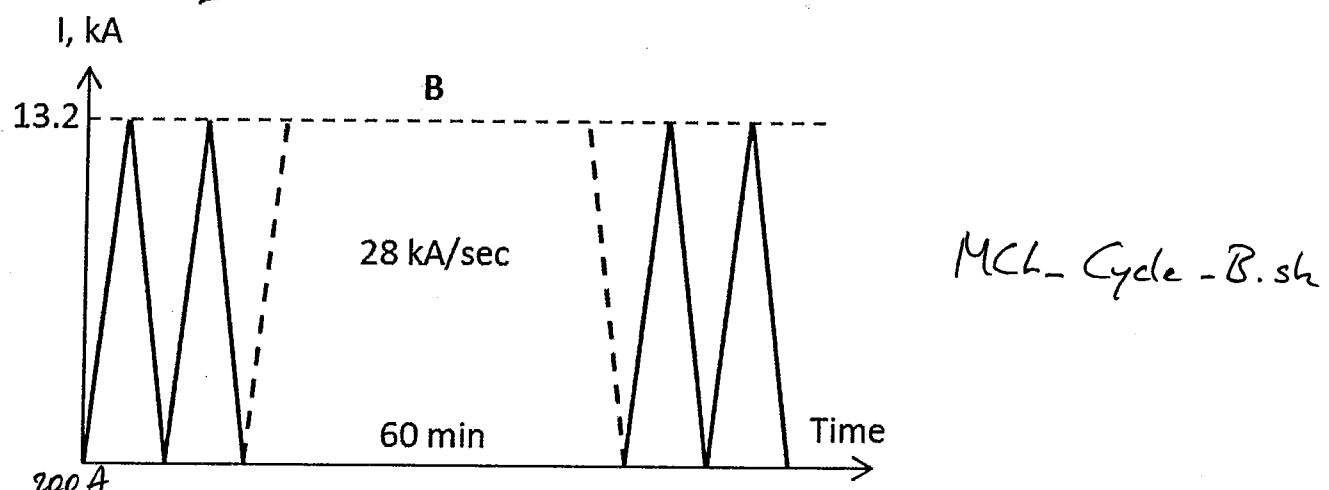

3. 17 kA training pulse (C) repeat at HTS temp.: 50K

